



REX POWER MAGNETICS


DIVISION OF TRANSFACTOR INDUSTRIES INC.
65 Basaltic Rd. Concord, ON, L4K 1G4 Canada
Tel: 905-695-8844, 1-800-387-2840 Fax: 905-695-8855
www.RexPowerMagnetics.com

ENERGY EFFICIENT TRANSFORMER

- 3 Phase Isolation
- Dry Type
- ANN Self Cooled

PRELIMINARY DRAWING ONLY
This drawing may NOT truly reflect our Final Design. Any resulting order(s) must be accompanied by, or refer to this drawing and be marked with any proposed changes.

Purchaser: TBA
 PO#: TBA
 SWO#: TBA
 Qty: TBA

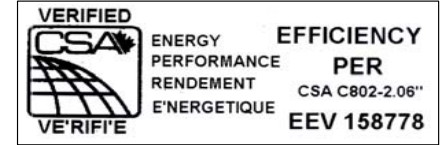

Coils: Aluminum
 Cat. No.: BA300J-M/Z

kVA: 300
 Primary: 600 Delta Volts
 Secondary: 208 Y/120 Volts
 Primary Taps: 2.5 %
 -Taps FCAN 2
 -Taps FCBN 2

Frequency: 60 Hz
 Sound Level: 55 dB Max.
 BIL: 10 kV
 Insulation Class: 220° C
 Temperature Rise: 150° C
 Impedance: 5.0 - 6.0 %

Min. Efficiency: 98.6 %
 - Calculated @ 35% Loaded

Weight: 1700 Lbs

| Termination | Location | Terminals |
|-------------|----------|----------------|
| Primary: | Front | 2-600 MCM 1/Ph |
| Secondary: | Front | 6-300 MCM 4/Ph |

Wiring Connection:

Primary: H1-H2-H3

| Voltage | % Tap | Links: |
|---------|-------|--------|
| 630 | 105.0 | 1-2 |
| 615 | 102.5 | 2-3 |
| 600 | 100.0 | 3-4 |
| 585 | 97.5 | 4-5 |
| 570 | 95.0 | 5-6 |

Secondary: X0-X1-X2-X3



| Voltage | Phase | Connect Loads To: |
|---------|-------|-------------------------------|
| 208 | 3 | X1-X2-X3 |
| 120 | 1 | X0-X1, X0-X2, and/or X0-X3 |

Standards:

1. CSA Certified
- File No. LR34493
2. UL Listed
- File No. E108255

Standard Features:

1. Anti-vibration pads installed between the enclosure base and the core & coil assembly
2. Ground lug provided
3. Transformer meets Efficiency per CSA C802.2
4. Transformer meets NEMA TP-1 Efficiency Level

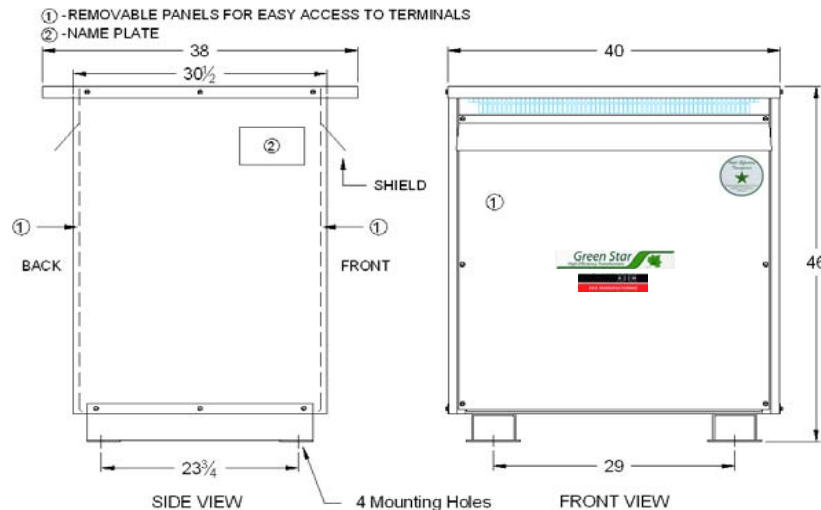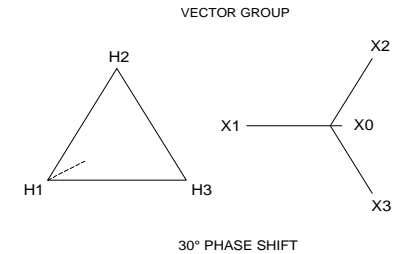

CSA Enclosure:

1. Type 3R (NEMA 3R)
- Sprinklerproof when the angle between sprinkler heads and opening in the enclosure does Not exceed 45 degree from the vertical.
2. Ventilated
3. ASA 61 grey
4. Floor mounting

| 2 | Updated Logo & Wgt. | AP | VS | May 13, 2011 |
|------|---------------------------|----|-------------|---------------|
| 1 | Updated Standard Features | SA | VS | Oct. 26, 2010 |
| REV# | Remarks | BY | Approved By | DATE |

Prepared by: SA
 Approved by: VS
 Date: OCT 26 2010