



DIVISION OF TRANSFACTOR INDUSTRIES INC.
 65 Basaltic Rd. Concord, ON, L4K 1G4 Canada
 Tel: 905-695-8844, 1-800-387-2840 Fax: 905-695-8855
 www.RexPowerMagnetics.com

TRANSFORMER SPECIFICATION

- 3 Phase Drive Isolation
- Dry Type
- ANN Self Cooled
- Suitable for Nonsinusoidal Current Load with a K-Factor Not to Exceed 4

PRELIMINARY DRAWING ONLY
 This drawing may NOT truly reflect our Final Design. Any resulting order(s) must be accompanied by, or refer to this drawing and be marked with any proposed changes.

Purchaser: TBA
 PO#: TBA
 SWO#: TBA
 Qty: TBA

Coils: Aluminum Wound
 Cat. No.: DA175H1-P1
 kVA: 175
 Primary: 460 Delta Volt
 Secondary: 460 Y/266 Volt
 Primary Taps: 2.5 %
 -Taps FCAN 2
 -Taps FCBN 2
 Frequency: 60 Hz
 Insulation Class: 220° C
 Temperature Rise: 150° C
 BIL: 10 kV
 Impedance: 4.0 - 5.0 %
 Weight: 1400 Lbs

| Termination | Location | Terminlas |
|-------------|----------|-----------|
| Primary: | Front | 6-300 MCM |
| Secondary: | Front | 6-300 MCM |

Wiring Connection:

| Primary: Voltage | H1-H2-H3 % Tap | Links: |
|------------------|----------------|--------|
| 483 | 105.0 | 1-2 |
| 472 | 102.5 | 2-3 |
| 460 | 100.0 | 3-4 |
| 449 | 97.5 | 4-5 |
| 437 | 95.0 | 5-6 |



| Secondary: Voltage | Phase | Connect Loads To: |
|--------------------|-------|----------------------------|
| 460 | 3 | X1-X2-X3 |
| 266 | 1 | X0-X1, X0-X2, and/or X0-X3 |

Standards:

1. CSA Certified
 - File No. LR34493
2. UL Listed
 - File No. E108255

Standard Features:

1. Anti-Vibration pads installed between the enclosure base and the core & coil assembly
2. Ground lug provided
3. NC 200°C thermostat installed at the centre coil
4. Neutral terminal rated 200% of the line terminals
5. K-4 Rated

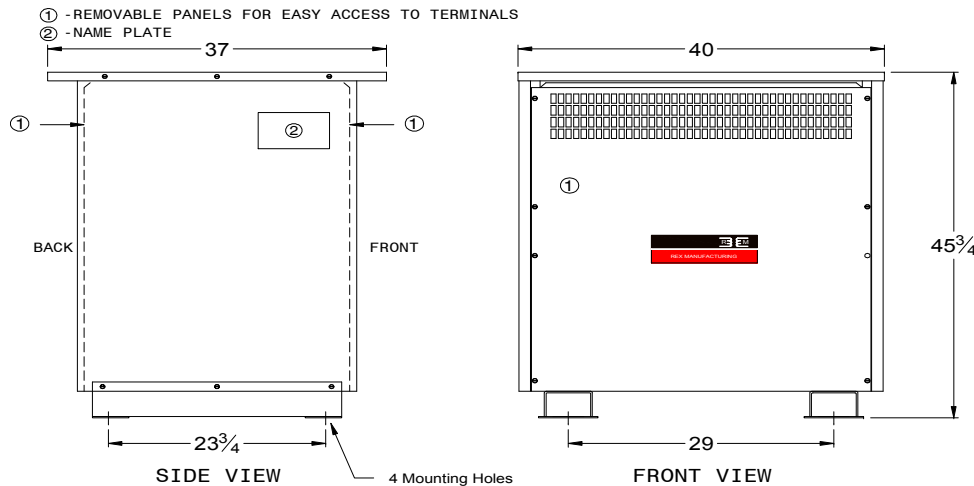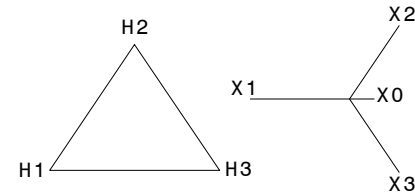

CSA Enclosure:

- Type 2 (NEMA 2)
- Indoor Ventilated
- ASA 61 Grey
- Floor Mounting

Prepared by: AP
 Approved by: VS
 Date: DEC.8, 2008